


4 LARGE CASTINGS - 4" METER

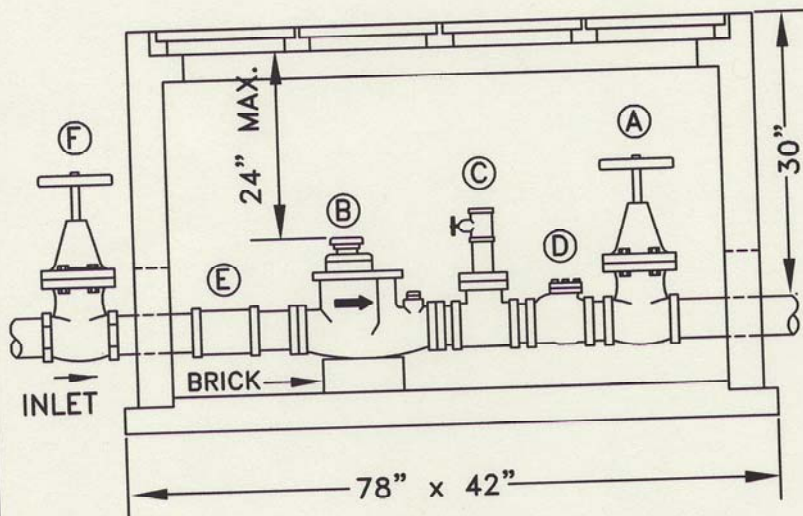

- Ⓐ 4" VALVE DOUBLE GATE IRON BODY OPEN LEFT
- Ⓑ 4" METER WITH FLANGE CONNECTION 2" TEST TEE OF BRASS
- Ⓒ 2" x 6" BRASS NIPPLE & 2" BRASS GATE VALVE
- Ⓓ 4" BRASS CHECK VALVE AS PER METRO WATER (ONLY IF BACKFLOW ARE NOT AT METER BOX)
- Ⓔ STRAINER REQUIRED WHEN TURBINE METER USED
- Ⓕ 4" GATE VALVE WITH BOX AND CASTING

NOTES:

- SEE METRO GOVERNMENT ORDINANCE NO. 65-412, SEC. 39-290, PAGE 47 FOR REGULATIONS REGARDING CHECK AND RELIEF VALVES.
- METERS ARE TESTED ANNUALLY AND A SHUT OFF OF SERVICE WILL BE NECESSARY IF INTERRUPTED WATER SERVICE PRESENTS A PROBLEM WE RECOMMEND A BATTERY INSTALLATION FOR YOUR WATER METERS.

RADIO READ UNIT (MXU) TO BE INSTALLED ON SERVICE LINES AS INDICATED BY METRO WATER SERVICES PERMIT OFFICE. REFERENCE DETAIL WDET002A-1 FOR LARGE METER BOX RADIO READ UNIT (MXU) CONDUIT AND MOUNTING LOCATIONS.

CONCRETE: 4500 PSI @ 28 DAYS REINFORCED WITH #4 BARS

MXU TO BE INSTALLED AS PER MANUFACTURES SPECIFICATIONS.

METRO WATER SERVICES

**METER BOX FOR 4" METER
FOR 4" SERVICE**

NOT TO SCALE DATE: 2/25/05
DWG. NO. WDET018C

METRO
WATER SERVICES

Hal Balithas
LICENSED DISTRIBUTION OPERATOR

[Signature]
DIRECTOR OF WATER AND SEWERAGE SERVICES